





Single Loop Fire Alarm Control Panel

The AX-CTL-1C is a member of the industry leading Axis AX product family. The AX-CTL-1C is a small, compact single loop fire alarm control panel for use in cost sensitive fire alarm installations, where less than 126 addressable points are required. The AX-CTL-1C contains all of the same features as the Advanced AX-CTL-1L, AX-CTL-2 and AX-CTL-4 intelligent fire alarm control panels however in a small compact enclosure. As a member of the Axis AX product line the AX-CTL-1C can easily be utilized in larger applications due to its optional peer-to-peer networking capabilities.

Designed with installation and service engineers in mind, the AX-CTL-1C single loop fire alarm control panel is modularly packaged, using surface mount and dual flash microprocessor technology, with onboard real time clocks for ease of installation, troubleshooting, programming and maintenance.

The AX-CTL-1C provides a single Style 4 or Style 6/7 Signaling Line Circuit (SLC). Communications to the field devices attached to the SLC is via an advanced, 100% digital protocol with advantages of being highly immune to noisy environments. The SLC supports up to 126 analog addressable devices (any combination of intelligent detectors, input and/or output devices, including loop powered technology devices). In addition, unique sub-addressing of various input and/ or output devices is permitted expanding on overall AX- CTL-1C system capacity.

The AX-CTL-1C comes with two filtered, voltage regulated Notification Appliance Circuits (NACs), Class A or B, each rated 2 Amp @ 24 VDC. Due to exceptional regulation and high rating, the onboard NAC outputs provide compatibility with most listed notification appliance devices.

The AX-CTL-1C single loop fire alarm control panel has resettable and non-resettable power outputs; each rated 0.5 Amp @ 24 VDC for connection to four-wire conventional smoke detectors and/or ancillary devices. Each AX-CTL-1C contains three, field programmable, Form "C" relay contacts rated 1 Amp @ 30 VDC, defaulted as a fail-safe trouble relay, alarm relay, and supervisory relay.

Simplifying and reducing initial system set-up, each AX- CTL-1C single loop fire alarm control panel is equipped with an installer-friendly "Auto-Learn/Loop Detection" feature that permits the rapid recognition of all signaling line circuit devices. This rapid recognition simplifies the assignment of critical life safety functions immediately. Assignments include: intelligent detector type and operation criteria, addressable input device recognition as an alarm input and addressable output control on a general alarm basis.



Features

- 126 Analog Addressable Points
- Advanced User Interface w/Graphical LCD
- "DynamiX" I/O Relationship Programming
- Synchronized Audible and Visual NAC Circuits
- Superior Service & Maintenance Diagnostics
- AD-NeT-PluS Peer-to-Peer Networking
- Automatic Drift Compensation per Detector
- Automatic Detector Testing w/Maintenance Alert
- Alarm Verification and P.A.S.
- Style 4, 6 & 7 SLC Operation (supports loop powered technology)
- Class A or B NAC Circuits
- Voltage Regulated NACs (compatible with most Listed NAC devices)
- Multi-Pattern and Two-Stage NAC Control

[900-028] 1.0 Page 1 of 5

Designed with built-in powerful installation and customization tools, the AX-CTL-1C can adapt to virtually any application requirement. With DynamiX programming, typical time consuming complexities associated with I/O relationship programming such as two-stage multi-pattern NAC control, intelligent detector drift compensation, precision response/sensitivity mode settings, flexible timing functions, and more, are sharply reduced.

The AX-CTL-1C single loop fire alarm control panels are fully field programmable, via the onboard graphical LCD display and alphanumeric keypad. Front panel programming may encompass defining input to output relationships, configuring output circuit characteristics, entering zone, device, and other text descriptions, and configuring multiple user-access level passwords.

To maximize the capability and flexibility of the single loop fire alarm control panel and to expand upon the customization of an installation, the standard Advanced Windows based PC-NeT field configuration tool is compatible with the AX-CTL-1C. The PC-NeT field configuration tool is a powerful, user-friendly programming tool that allows users to perform virtually any I/O relationship with multiple criteria. Simple drop-down menus with point-and-click operation make project commissioning and troubleshooting fast and efficient.

The AX-CTL-1C single loop fire alarm control panel can accommodate remote graphical LCD annunciators (with or without system control capabilities) on the Ad-NeT- PluS peer-to-peer network. Multiple annunciator locations can be created based on installation demands. These locations can have either: no system control, partial system control, or full system control. When installations exceed a single panel's capacity, the Advanced Ad-NeT-PluS peer-to-peer network may be implemented, providing up to 200 network nodes. The Ad-NeT-PluS is completely field programmable for inter panel functionality or segregation of information and control based on installation requirements.

Designed with the technician in mind, each module of the AX-CTL-1C single loop fire alarm control panel is easy to install and service.

Features Cont.

- Network-Wide Audible and Visual Synchronization
- "Auto-Learn/Loop Detection" Programming
- Built-in Intelligent Multi-Meter
- Optional ipGateway for text and email status notification
- SLC Circuit Compatibility with Xtralis VLC-400

Listings and Approvals

- ETL ANSI/UL 864 Listed: 101564744NYM-001
- CSFM Approved: Pending
- NYCFD COA 6105A2

The integral power supply offers status LEDs, temperature compensated charging, and the ability to operate directly from the batteries when AC supply is not yet available at the installation site. A unique built-in intelligent multi-meter allows technicians to interrogateany input and/or output and diagnose potential time consuming trouble issues with virtually no complications or aggravation.

With an AX-CTL-1C single loop fire alarm control panel, servicing a customer after installation can be as simple as adding an Advanced ipGateway (AX-LAN). The ipGateway can provide real time text and email alerts of system status via internet access.

Graphical Liquid Crystal Display Navigation Buttons



LED Status Indicators

Control Buttons 12 Button Keypad
(Numbers & Letters)

Advanced User Interface w/Graphical LCD:

Designed to be user-friendly and easy to operate, the Advanced User Interface w/Graphical LCD (backlit 240 x 64) is the information and control center for the AX-CTL-1C single loop fire alarm control panel.


The unit incorporates a graphical LCD display, LED status indicators, control buttons (including 3 programmable buttons), navigation buttons, and a 12 button keypad for complete system status, interrogation, and control.

[900-028] 1.0 Page 2 of 5

Button (Keys)		
9	Reset	
\bigcirc	Ack (panel buzzer acknowledge)	
	Resound (resound signals)	
\mathscr{D}	Silence (silence signals)	
®	Fire Drill	
	Function Keys (3 - programmable control buttons)	
- ∳-	Navigation Keys (up, down, left, right, and tick [enter])	
202 202 202	12 Button Keypad (numbers, letters, esc, and menu)	

LED Indicators	
Alarm	Red
Pre-Alarm	Red
Disable	Yellow
Test	Yellow
P.A.S.	Yellow
Power	Green
Supervisory	Yellow
NAC Silenced	Yellow
NAC Trouble	Yellow
NAC Disabled	Yellow
System Trouble	Yellow
Programming	Yellow
Programmable LED 1	Red
Programmable LEDs 2-5	Yellow

Wiring Diagram

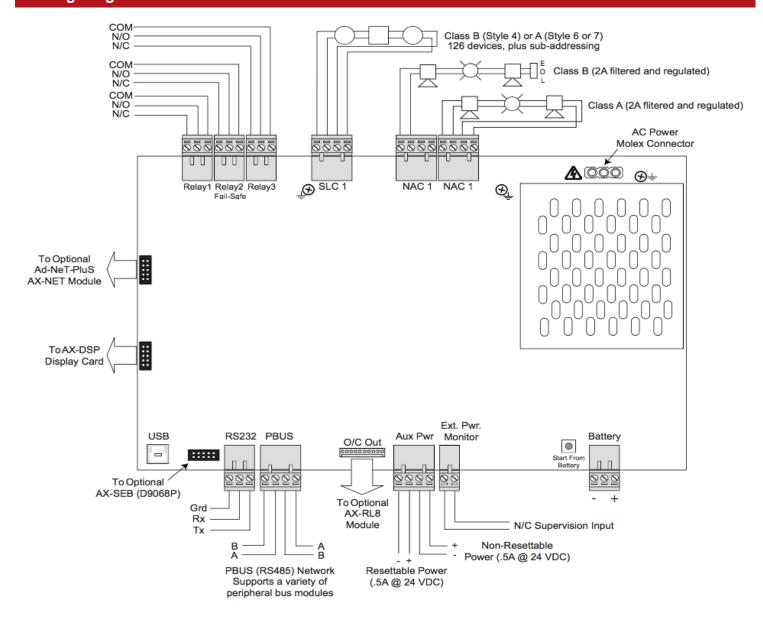

[900-028] 1.0 Page 3 of 5

Specification		
Operating Voltage	120 VAC (1.4A) - 240 VAC (0.7A), 50/60Hz	
System-Brown-Out	98 VAC nominal	
Battery Circuit Charging Voltage Temp. Compensated Charging Current Battery Derating Factor Battery Capacity Battery Fuse	27.4 VDC nominal 2 Amp 0.83A 7 Ah (minimum), 48 Ah (maximum) 5A @ 240 VAC, Time Delayed, Ceramic, High Breaking (In-line Wire Link)	
Fire, Supervisory, and Trouble Relays Type Rating Trouble Relay	(Power Limited - when utilizing system power) Form "C" 1A @ 30 VDC/VAC Normally Active (fail-safe operation)	
Auxiliary Power Outputs Resettable Voltage Current Reset Time Non-Resettable Voltage Current	(Power Limited) 24 VDC 0.5A 10-15 Seconds 24 VDC 0.5A	
Humidity	85% RH	
Temperatures Operating Recommended Room	32 °F - 120 °F (0 °C - 49 °C) 60 °F - 86 °F (15 °C - 27 °C)	
Enclosure Dimensions	17 7/8"H x 14 3/4"W x 5 5/8"D	
SLC Loop Class (Style) Voltage Minimum Return Voltage Current	(Power Limited) Class A or B (Style 4, 6 or 7) 24 VDC 17 VDC 0.5A	
NAC Circuits Class (Style) Voltage Minimum Return Voltage Current Maximum Voltage Drop Maximum Line Impedance	(Power Limited) Class A or B 24 VDC (filtered and regulated) 16 VDC 2A (each) 3 VDC 1.5Ω	
RS232 Baud Rate Parity Data Bits Stop Bits	Supervised, Optically Isolated 9600 None 8 1	
Base Card Operating Current AX-CTL-1PCB	Quiescent Alarm 110 mA 195 mA	

^{*} Refer to individual Axis AX Series module data sheets for specific specifications regarding optional modules.

[900-028] 1.0 Page 4 of 5

Order codes and Options			
AX-CTL-1C*	Single Loop Fire Alarm Control Panel with power supply/charger, 1 SLC, 2 NACs, 3 auxiliary relays (enclosure supports batteries 7Ah - 18Ah)		
AX-CTL-1C-BCP*	Optional Battery Cover (Dress) Plate		
AX CTL Base Card Option Modules**:			
AX-NET4	Network Interface Card (Style 4)		
AX-NET7	Network Interface Card (Style 7)		
AX-RL8	8-Way Relay Output Card (Programmable)		
D9068P	Serial Expansion Board, requires AX-SEB and AX-DACT		
AX-SEB	Serial Expansion Board, Required with D9068P		
AX-DACT	DACT Metal Mounting Plate, required with D9068P		

^{*} For gray enclosure, add the suffix "G" to the part number.

[900-028] 1.0 Page 5 of 5

^{**} Refer to individual Axis AX module data sheets for peer to peer network and peripheral bus optional modules.